



## Stability Analysis of Optimized PMU Placement using Hybrid and Individual TLBO-PSO Techniques

Santosh Kumari Meena\*, Akhil Ranjan Garg

Electrical Engineering Department, MBM University, Jodhpur-342011, India

\*[santosh.ec@mbm.ac.in](mailto:santosh.ec@mbm.ac.in)

**Abstract** In power system to optimized PMUs is a critical task to ensure maximum network observability while minimizing installation costs. This study presents a comparative analysis of three optimization techniques: Teaching-Learning-Based Optimization (TLBO), Particle Swarm Optimization (PSO), and a hybrid TLBO-PSO approach, focusing on their efficiency in determining the best PMU placements. Individual methods, such as TLBO and PSO, are often limited by longer computation times and the requirement for a higher number of PMUs to achieve full observability. In contrast, the hybrid TLBO-PSO method demonstrates significant improvements, consistently delivering solutions with fewer PMUs, faster computation times, and higher placement accuracy. By evaluating performance of these techniques on IEEE 14bus, 30bus and 57 bus systems through simulations conducted over 100 iterations for each method in every test case. The results highlight the hybrid approach's superior efficiency compared to individual methods. Furthermore, comparisons with prior research confirm that the hybrid TLBO-PSO approach is a robust and reliable solution for minimizing PMU installations while ensuring complete system observability.

**Keywords:** Optimal PMU placement(OPP), Particle Swarm Optimization (PSO), Teaching-Learning Based Optimization (TLBO), Hybrid TLBO-PSO Approach, redundancy index, Stability analysis,

*(Received 2024-11-17, Accepted 2025-01-24, Available Online at 2025-01-31)*

### 1. Introduction

This Phasor Measurement Units (PMUs) are essential devices for modern power system monitoring, introduced in the 1980s to provide fast and intelligent communication within smart grids. PMUs measure voltage and current phasors, accurately time-stamped via Global Positioning System (GPS) technology, which allows synchronization of data from widely dispersed locations across the power system. Compared to traditional SCADA systems, PMUs offer higher accuracy due to their faster sampling rates [4]. This synchro-phasor technology enables real-time monitoring, fault detection, protection, and control, enhancing the overall reliability of the power grid [5]. Once data is collected by PMUs, it is transmitted through optical fiber to a centralized Phasor Data Concentrator (PDC), where the data is aligned and stored for post-dispatch analysis. This process supports stability by allowing timely actions in response to grid events. The challenge is to find optimized PMUs and their optimal locations to ensure complete observability of power system networks. Earlier various optimization techniques have been used to solved the optimization problem effectively.

### 1.1. Analysis of optimal PMUs placement methods

Conventional and heuristic optimization methods have been applied to the Optimal PMU Placement (OPP) problem. Conventional methods, such as Integer Linear Programming (ILP), used for optimal PMUs required for full observability. The Conventional Technique works well for simpler problems but requires more computation time, making it less effective for complex tasks. It is also less accurate because it is based on many physical assumptions. On the other hand, the Heuristic Technique is well-suited for solving complex problems by mimicking human-like decision-making, and it relies mainly on data with fewer assumptions. This leads to higher accuracy and faster performance, making it ideal for time-sensitive applications. Table 1 compares the properties of Conventional and Heuristic techniques in the context of PMU.

**Table 1.** Comparative analysis of Conventional and Heuristic Technique

S.No.	Properties	Conventional Techniques	Heuristic Techniques
1.	Size of Problem	Works well for simpler networks.	Solves complex problems by mimicking human-like methods.
2.	Data Requirement	Based on physical principles and assumptions.	Relies mainly on data with fewer assumptions.
3.	Accuracy	Less accurate due to multiple assumptions.	More precise with minimal failures.
4.	Effectiveness	Slower, requires more computation time.	Faster, ideal for time-intensive tasks.

These techniques highlight the need to balance computational efficiency, scalability, solution precision, and the ability to manage uncertainties within the power grid. By incorporating hybrid methods, the performance of individual algorithms is significantly improved, offering the advantages of multiple approaches and delivering enhanced optimization outcomes.

### 1.2 PMU placement formulation

The main objective is to find the minimum number of Phasor Measurement Unit required and its best location to monitor complete power system to achieve complete observability for the power network. Thus, the Objective function is formulated as below

$$\text{minimize } \sum_{k=1}^N x_k \quad (1)$$

Where N is a number of system buses and  $x_k$  is a binary decision variable, where:

$$x_k = \begin{cases} 1, & \text{if pmu installed at bus } k, \\ 0, & \text{otherwise} \end{cases}$$

Constraints:

The constraint ensures that every bus in the network is observable either directly by PMU at that particular bus or indirectly through its connected neighbours.

$$[A] \times [X] \geq [b]$$

where  $[A]$  is a binary connectivity matrix of size  $N \times N$ . Entries for matrix  $[A]$  are defined as follows:

$$A_{ij} = \begin{cases} 1 & \text{if } i = j \\ 1 & \text{if } i \text{ and } j \text{ are connected} \\ 0 & \text{if otherwise} \end{cases}$$

Meanwhile  $[X]$  is defined as a binary decision variable vector of size  $N \times 1$  define as:

$$[X] = [x_1, x_2, x_3 \dots \dots \dots x_N]^T$$

$[b]$  is a column vector of ones, of size  $N \times 1$ , representing the requirement for each bus to be observable

$$[b] = [1, 1, 1 \dots \dots \dots 1]^T$$

Fitness Function Formulation:

Given the components, the fitness function for the hybrid TLBO-PSO technique can be expressed as:

$$f(x) = \sum_{i=1}^N x_i + \lambda \times \text{Penalty}(x) \quad (2)$$

Penalty Function: It penalizes solutions that do not satisfy the observability constraint. If a solution does not meet the constraint, a penalty proportional to the violation is added to the fitness value.  $\lambda$  is a penalty factor (a large positive constant) that ensures the constraint violation has a significant impact on the fitness value.

The penalty function could be defined as:

$$\text{Penalty}(x) = \begin{cases} 0, & \text{if } [A]x[X] \geq [b] \\ \text{Large positive value}, & \text{if } [A]x[X] \leq [b] \end{cases}$$

Final Fitness Function:

$$f(x) = \text{Min}[\sum_{i=1}^N x_i + \lambda \times \max(0, [b] - [A] \times [X])] \quad (3)$$

The first term  $\sum_{i=1}^N x_i$  encourages minimizing the number of PMUs.

The second term  $\lambda \times \max(0, [b] - [A] \times [X])$  adds a penalty if the solution violates the observability constraint.

SORI i.e. system observability redundancy index which is sum of bus observability for all buses. Maximizing the measurement redundancy value ensures that a major portion of the system remains observable in case of a PMU failure.

## 2. Research Methods

### 2.1 Particle Swarm Optimization (PSO)

The fundamental principle of (PSO) (de Valle et al., 2008) is inspired by behavior of a flock of birds, a school of fish, or a swarm of bees. In PSO, multiple agents, or particles, are utilized to search for the optimal solution to the problem at hand. The movement of these particles toward the optimal solution is influenced by both their individual experiences and the collective knowledge of the swarm. As illustrated below, the position of a particle at any given moment is determined by its current velocity and its position from the previous moment

$$x_i^{(t+1)} = x_i^t + v_i^{(t+1)} \quad (4)$$

Where  $x_i^{(t+1)}$  and  $x_i^t$  is a vector which indicates position of  $i_{th}$  particle at time instant  $t+1$  and  $t$  respectively, and  $v_i^{(t+1)}$  is the velocity vector of the particle.

The velocity vector is updated by using the experience of the individual particles, as well as the knowledge of the performance of the other particles in its neighbourhood. The velocity update rule for a basic PSO is

$$v_i^{(t+1)} = w * v_i^t + c_1 * r_1 * (p_{best_i} - x_i^t) + c_2 * r_2 * (g_{best} - x_i^t) \quad (5)$$

where  $i=1,2,3,\dots,n$  and  $n$  is population size,  $v_i^t$  is the particle  $i$  velocity at time  $t$ ,  $x_i^t$  is the position of particle  $i$  at time  $t$ ,  $w$  is the inertia weight, which balances exploration and exploitation,  $c_1$  and  $c_2$  are cognitive and social coefficients, respectively,  $r_1$  and  $r_2$  are random values uniformly distributed in  $[0,1]$ ,  $p_{best_i}$  is the personal best position of particle  $i$ ,  $g_{best}$  is the global best position found by the swarm.

### 2.2 Teaching Learning Based Optimization Algorithm (TLBO)

Teaching-Learning-Based Optimization (TLBO) is an optimization method inspired by the process of teaching and learning in a classroom. Proposed by Rao, Savsani, and Vakharia in 2011, TLBO mimics the impact of a teacher on learners and the interaction among learners to improve their knowledge. In the TLBO algorithm, the population consists of learners (solutions). The algorithm operates in two phases: the "Teacher Phase" and the "Learner Phase."

Teacher Phase: In this phase, the best result in the population, taken as as the teacher ( $x_{Teacher}$ ), and always tries to betterment the mean result of the class (population) by moving the learners towards the teacher's knowledge level. The update rule in this phase is:

$$x_{new} = x_i + r * (x_{Teacher} - T_F \cdot M) \quad (6)$$

$x_i$  is the current solution of  $i$ ,  $x_{Teacher}$  indicates best solution in the current population (teacher),  $T_F$  is the teaching factor, typically set to either 1 or 2,  $M$  is the mean of the current population, is  $r$  a random number of  $[0,1]$ .

Learner Phase: In this phase, learners increase their knowledge by interacting with each other. Each learner pairs with another random learner and updates its solution based on the knowledge gained from the interaction. The update rule in this phase is:

$$x_{new,i} = x_{old,i} + r_i(x_j - x_i) \quad \text{if } (x_j) < (x_i) \quad (7)$$

$$x_{new,i} = x_{old,i} + r_i(x_i - x_j) \quad \text{if } (x_i) < (x_j) \quad (8)$$

$x_i$  representing the current solution in the solution space,  $x_j$  representing a different solution in the solution space,  $r$  is a scalar, typically a random number of  $[0,1]$  or a parameter that controls the step size of the update.

### 2.3 Hybrid TLBO-PSO Algorithm

The TLBO algorithm emulates the behavior of the teacher teaching the student and the student learning from the teacher. The PSO algorithm emulates the food-searching behavior algorithm for birds. The fitness function defined in figure 2 is subjected to convergence by using the hybrid algorithm of TLBO-PSO that helps in better convergence in the defined problem. The fitness function is design for optimal PMU placement in power system ensuring complete observability.

The hybrid algorithm combines the PSO update rules with the TLBO teacher and learner phases. TLBO is using as local search capacity. In PSO algorithm at each iteration, the particles' velocities and positions are updated, followed by improvements using TLBO's teacher and learner phases. The fundamental concept of hybrid TLBO-PSO is to combine the social thinking capacity ( $g_{best}$ ) in PSO with TLBO's local search capacity. Finally  $g_{best}$  is considered as best optimal solution for PMU placement. The output of TLBO result given for initialization for PSO algorithm. The Hybrid algorithm implementation process is given by flow chart given below.

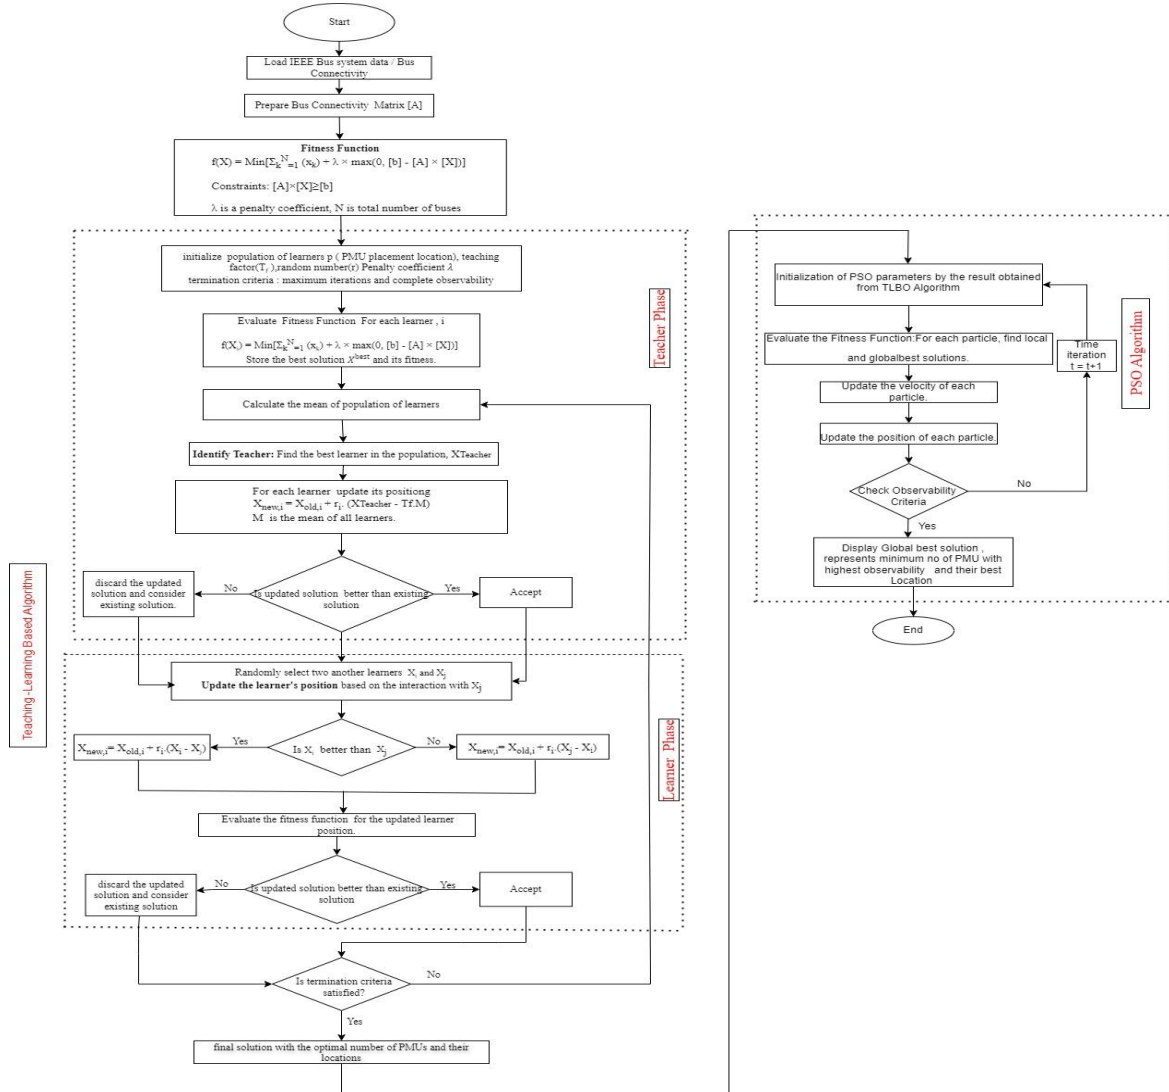


Figure 1. Flow chart for Hybrid TLBO -PSO method

### 3. Results and Discussion

Simulations is performed on IEEE 14, 30 and 57 bus test systems. The simulations are carried out in MATLAB 2021a environment on intel(R) Core(TM) i5-8265U CPU @ 1.60GHz 1.80 GHz, 64-bit operating system, x64-based processor. All three methods are executed for IEEE 14, 30 and 57bus systems for normal cases without considering ZIB and other factors and find the result for optimal placement of PMU's, various possible PMU numbers and their best locations and count of each PMU location for every 100 iteration. The results obtained are as follows for each systems: Simulations are performed on IEEE 14, 30 and 57 bus test systems.

The **Hybrid Method** consistently achieves the best solution with the minimum number of PMUs.


The **PSO** method shows less consistency than the Hybrid Method and the **TLBO** method tends to indicating slightly less optimal results compared to the Hybrid Method.

**Case 1: IEEE 14 Bus System:**


Fitness values (Min. no of PMU), Possible PMU Locations, SORI and No. buses observed multiple times once of PSO, TLBO, and proposed TLBO-PSO algorithms for IEEE 14 bus system are tabulated in Table 2.

**Table 2.** Different solutions for IEEE 14 bus system

Min no of PMUs	Location of PMUs	SORI	No. buses observed multiple times
4	2,6,7,9	19	4
4	2,7,11,13	16	2
4	2,6,8,9	17	3
4	2,7,10,13	16	2
4	2,8,10,13	14	0

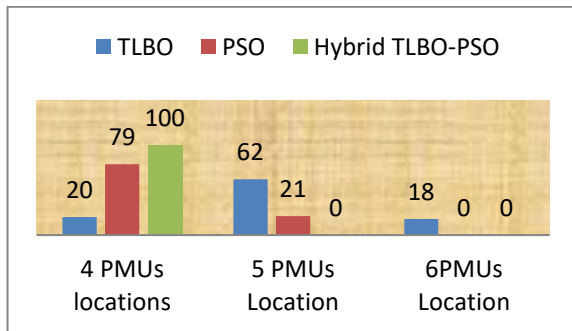

**Figure 2.** comparison of PMU Number for 100 iterations for IEEE 14 Bus system

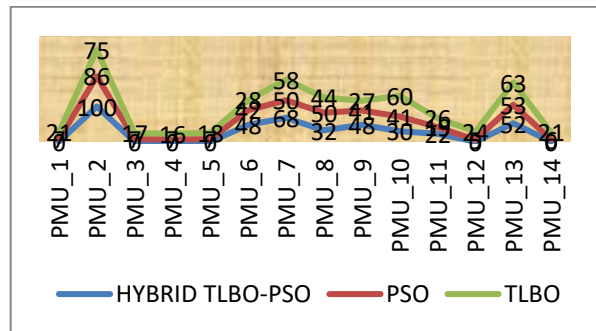

**Figure 3.** Comparative analysis of PMUs Count for 100 solutions for IEEE 14 Bus


Figure 2 clearly shows that the PMUs requirement are less for the TLBO-PSO algorithm than the PSO and TLBO algorithm. Figure 3 shows the result for of PMUs Count for 100 iteration. These underscores the effectiveness of the Hybrid Method in minimizing the number of PMUs, as it achieves the optimal count in all iterations.

**Case 2: IEEE 30 Bus System:**


The comparative results obtained from the all three methods are shown in table 3. The best SORI value achieved is 52, with a minimum of 10 PMUs necessary for complete observability and 12 buses observed more than once.

**Table 3.** Different Solutions for IEEE 30 Bus System

Min no of PMUs	Optimal Location of PMUs	SORI	No. buses observed multiple times once
10	2,4,6,9,10,12,15,20,25,27	52	12
10	2,4,6,9,10,12,15,18,25,27	52	12
10	1,2,6,9,10,12, 15, 19, 25, 27	50	14
10	2,4,6,9,10,12,19,24,25,27	51	12
10	1,2,6,9,10,12,15,20,25,29	48	11
10	2, 4, 6, 10, 11, 12, 19, 24, 30	46	10

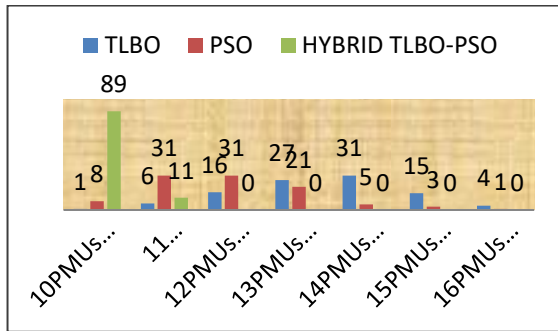

**Figure 4.** Comparison of PMU Number and location for 100 iterations for IEEE 30 Bus system

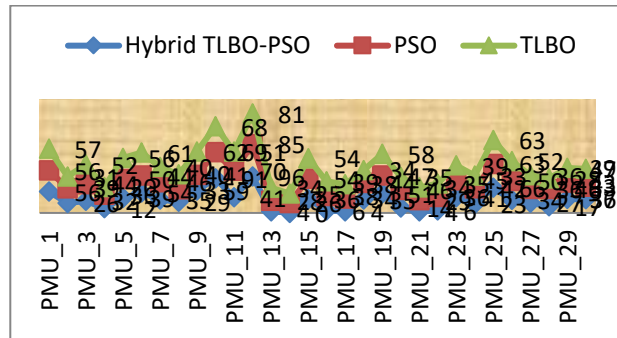

**Figure 5.** Comparative analysis of PMUs Count for 100 solutions for IEEE 30 Bus system

Figure 4 illustrates the superior performance of the hybrid algorithm compared to the other two methods. In 100 iterations, the hybrid algorithm achieved the minimum number of PMUs in 89 instances, whereas PSO and TLBO achieved this only 8 and 1 times, respectively. Additionally, the maximum number of PMUs required by the hybrid method is only 11, significantly lower than the other methods, which require up to 16 PMUs. Figure 5 Comparative analysis of PMUs Count for 100 solutions for IEEE 30 Bus system.


**Case 3: IEEE 57 Bus System:**

The comparative results obtained from the all three methods are shown in table4. The best SORI value achieved is 72, with a 17 PMUs gives for complete observability. Additionally, 15 buses observed more than once.


**Table 4.** Different Solutions For IEEE 57 Bus System

Min no of PMUs	Locations of PMUs (P)	SORI	No. buses observed multiple times
17	1,4,6,9,15,20,24,25,28,32,36,38,41,46,51,53,57	72	15
17	1,4,6,9,15,20,24,25,28,32,36,38,41,47,51,53,57	72	15
17	1,4,9,15,20,22,25,26,29,32,36,38,41,46,50,53,57	71	13
17	1,4,9,15,20,24,28,29,31,32,36,38,41,47,50,54,57	71	14
17	1,6,13,15,19,22,25,27,32,36,38,41,47,51,52,55,57	70	12



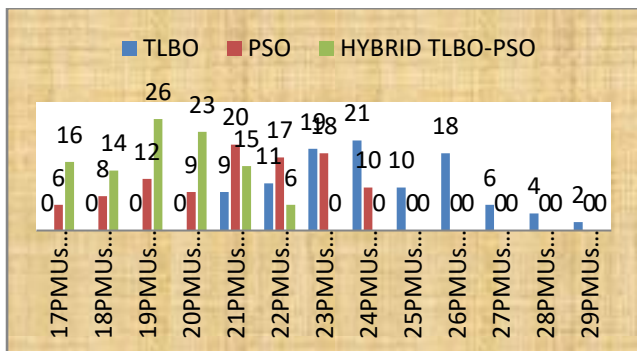

**Figure 6.** Comparison of PMU Number and location for 100 iterations for IEEE 57 Bus system

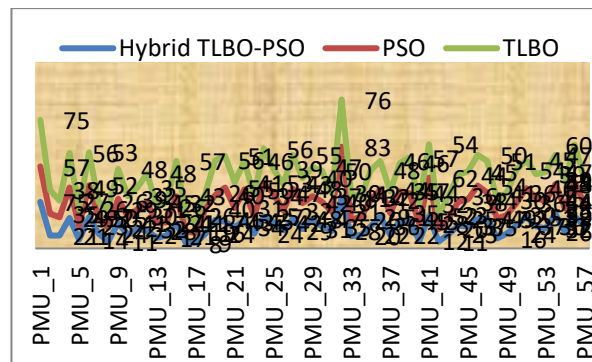

**Figure 7.** Comparative analysis of PMUs Count for 100 solutions for IEEE 57 Bus

Figure 7 illustrates the superior performance of the hybrid algorithm compared to the other two methods. In 100 iterations, the hybrid algorithm achieved the minimum number of PMUs in 16 instances, whereas PSO and TLBO achieved this only 6 and 0 times, respectively. Additionally, the maximum number of PMUs required by the hybrid method is only 17, significantly lower than the other methods, which require up to 16 PMUs. Figure 6 Comparative analysis of PMUs Count for 100 solutions for IEEE 57 Bus system.

Table 5: The Hybrid TLBO-PSO method demonstrates superior computational efficiency. Average execution times are significantly faster compared to PSO, TLBO, Modified BPSO and ABC algorithms.

**Table 5.** Comparative analysis of Computation Efficiency for various IEEE systems

Method	Average execution time in (seconds)		
	IEEE 14 Bus	IEEE 30 Bus	IEEE 57 Bus
<b>Hybrid TLBO-PSO</b>	<b>3.9407</b>	<b>16.8493</b>	<b>34.3346</b>
<b>PSO</b>	17.2106	44.8387	55.7126
<b>TLBO</b>	45.4108	87.0084	145.1668
<b>Artificial Bee Colony (ABC) Kulanthaisamy et al. (2014)</b>	40	54	303
<b>Modified BPSO, Hajian and Ranjbar</b>	60	360	2580

Table 6: The Hybrid TLBO-PSO method exhibits the highest stability for all cases in comparison, PSO and TLBO show lower stability. This table highlighting the robustness of the hybrid approach in achieving consistent optimal solutions.

**Table 6.** Comparative analysis of stability of each method

Method	Analysis of achieving the optimal solutions for 100 trials (Stability)		
	14 bus	30 bus	57 bus
<b>Hybrid TLBO-PSO</b>	100	89	16
<b>PSO</b>	79	24	6
<b>TLBO</b>	20	7	1

Table 7: The percentage of PMUs required for observability is as follows: 28% for 14 Bus, 33% for 30 Bus, 29% for 57 Bus, and 27% for 118 Bus, demonstrating efficient PMU placement relative to system size.

**Table 7.** Optimal Solutions for various IEEE systems

IEEE Bus Systems	Min. no. PMUs	Locations of PMUs	n PMU /N, %	SORI
<b>14 bus</b>	4	2, 6, 7, 9	28%	19
<b>30 bus</b>	10	1,2,6,9,10,12, 15, 19, 25, 27	33%	50
<b>57 bus</b>	17	1,4,6,9,15,20,24,25,28,32,36,38,41,46,51,53,57	29%	72

#### 4. Conclusion

After conducting 100 trial runs, the optimized PMUs and their locations are determined. All the algorithms tested successfully provided best solutions for the PMU placement problem. However, the TLBO algorithm, while effective, required more computational time and did not consistently yield superior results. In contrast, the PSO algorithm performed better, offering improved results with shorter computation times. Most notably, the hybrid TLBO-PSO algorithm demonstrated superior reliability and accuracy, consistently achieving the minimum number of PMUs compared to the individual TLBO and PSO algorithms.

#### 5. References

- [1] Phadke AG, Thorp JS, Adamiak MG. A new measurement technique for tracking voltage phasors, local system frequency, and rate of change of frequency. *IEEE Trans Power Apparatus Syst.* 1983;PAS-102(5):1025–38.
- [2] Dua D, Dambhare S, Gajbhiye RK, Soman SA. Optimal multistage scheduling of PMU placement: An ILP approach. *IEEE Trans Power Deliv.* 2006;23(4):1812–20.
- [3] Kavasseri R, Srinivasan SK. Joint placement of phasor and power flow measurements for observability of power systems. *IEEE Trans Power Syst.* 2011;26(4):1929–36.
- [4] Singh R, Srivastava SC. Optimal PMU placement for power system observability using binary particle swarm optimization. *Adv Sustain Sci Eng Technol.* 2021;1(3):67–79.
- [5] Ahmadi A, Alinejad-Beromi Y, Moradi M. Optimal PMU placement for power system observability using binary particle swarm optimization and considering measurement redundancy. *Expert Syst Appl.* 2011;38(6):7263–9.
- [6] Manousakis NM, Korres GN, Georgilakis PS. Taxonomy of PMU placement methodologies. *IEEE Trans Power Syst.* 2012;27(2):1070–7.

- [7] Gou B. Generalized integer linear programming formulation for optimal PMU placement. *IEEE Trans Power Syst.* 2008;23(3):1099–104.
- [8] Chakrabarti S, Kyriakides E. Optimal placement of phasor measurement units for power system observability. *IEEE Trans Power Syst.* 2008;23(3):1433–40.
- [9] Marin FJ, Garcia-Lagos F, Joya G, Sandoval F. Genetic algorithms for optimal placement of phasor measurement units in electric networks. *Electron Lett.* 2003;39(20):1403–5.
- [10] Aminifar F, Lucas C, Khodaei A, Firuzabad MF. Optimal placement of phasor measurement units using immunity genetic algorithm. *IEEE Trans Power Deliv.* 2009;24(3):1014–20.
- [11] Hajian M, Ranjbar AM, Amraee T, Mozafari B. Optimal placement of PMUs to maintain network observability using a modified BPSO algorithm. *Int J Electr Power Energy Syst.* 2011;33(1):28–34.
- [12] Abdolahi A, Taghizadegan Kalantari N. Precision enhancement of distribution system state estimation via tri-objective micro phasor measurement unit deployment. *Adv Sustain Sci Eng Technol.* 2023;3(2):45–58.
- [13] S. Mahmud, “Analysis of Listen Before Talk Protocol Implementation in Terrestrial Network Using Multi-Node LoRa Communication,” *Adv. Sustain. Sci. Eng. Technol.*, vol. 5, no. 3, p. 0230301, 2023.
- [14] Saleh AA, Adail AS, Wadoud AA. Optimal phasor measurement units placement for full observability of power system using improved particle swarm optimization. *IET Gener Transm Distrib.* 2017;11(7):1794–800.
- [15] Laouid AA, Mohammedi RD, Rezaoui MM, Kouzou A. Optimal PMU placement to ensure power system observability under various contingencies. *Electrotehn Electron Autom.* 2020;68(1):76–86.
- [16] Zhai C, Zhang H, Xiao G, Pan T. A model predictive approach to protect power systems against cascading blackouts. *Int J Electr Power Energy Syst.* 2019;113:310–21.
- [17] Ye H, Tian C, Ge Y, Wu L. Revisit optimal PMU placement with full zero-injection cluster and redundancy sharing. *IEEE Trans Power Syst.* 2024;39(5):1234–40.
- [18] Rahman NHA, Zobaa AF. Integrated mutation strategy with modified binary PSO algorithm for optimal PMU placement. *IEEE Trans Ind Informat.* 2017;13(6):3124–33.
- [19] Enshae A, Hooshmand RA, Fesharaki FH. A new method for optimal placement of phasor measurement units to maintain full network observability under various contingencies. *Electr Power Syst Res.* 2012;89:1–10.
- [20] Rather ZH, Liu C, Chen Z, Thogersen P. Optimal PMU placement by improved particle swarm optimization. In: *IEEE Innovative Smart Grid Technol-Asia (ISGT Asia)*. 2013. p. 1–6.
- [21] Sadu A, Kumar R, Kavasseri RG. Optimal placement of phasor measurement units using particle swarm optimization. In: *World Congr Nat Biol Inspired Comput (NaBIC)*. 2009. p. 1708–13.
- [22] RU Khan, R Kumar, N Khan, X Zhang, I Ahad “Optimizing a Deep Learning Model in Order to Have a Robust Neural Network Topology” *International Journal of Modeling and Optimization*, 2018.
- [23] MATPOWER: A MATLAB Power System Simulation Package [Online]. Available: <http://www.pserc.cornell.edu/matpower>